


HBL20SPFR Hubbell Inc. 20A/125V Female Panel Mount  
HBL20SPMR Hubbell Inc. 20A/125V Male Panel Mount

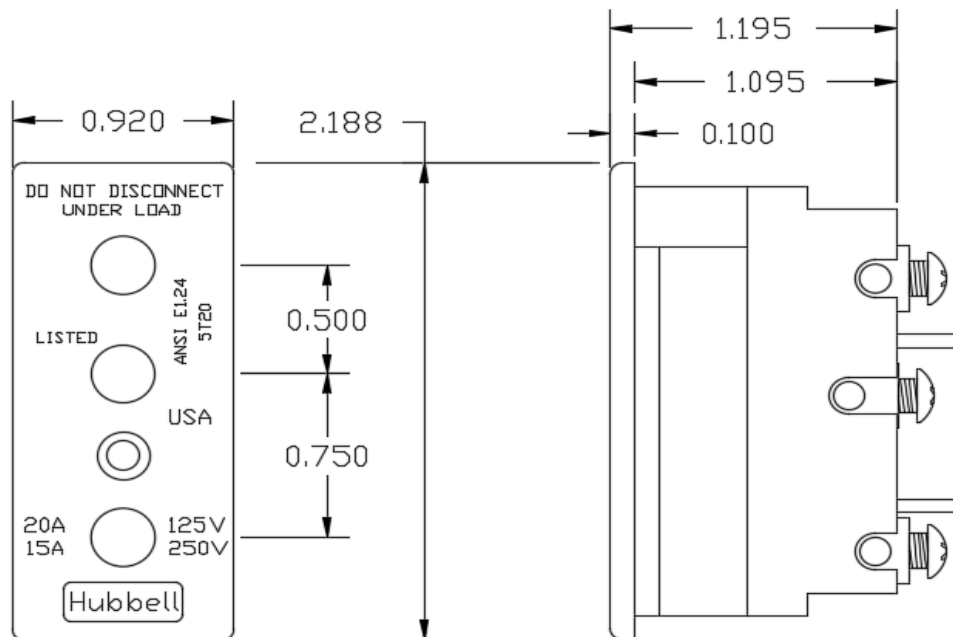

Panel Cutout - 0.75" x 2.00". 16 gauge. 0.060" material.

Push device rearward through cutout and tighten mounting screw to 7 in-lbs. torque.

Grounding terminal need not to be wired separately when mounted to conductive panel. The Mounting Strap provides a conductive path between grounding terminal and the panel.

Wire termination – two methods of wire termination are offered for the Hubbell Panel Mounts.

Slip wire shoe (provided) over strands. Insert through cross hole and terminate with 12 in-lbs torque.

#8 Ring Terminal may be crimped onto wire and attached with terminal screw at 12 in-lbs torque.

**Wiring Device-Kellems**  
**Hubbell Incorporated (Delaware)**  
**1-800-288-6000**  
**Shelton, CT 06484**  
[www.hubbell-wiring.com](http://www.hubbell-wiring.com)  
**PD2828 09/17**



Distributor:



Phone: 407-857-8770

Fax: 407-857-8771

Email: [sales@techni-lux.com](mailto:sales@techni-lux.com)

[www.techni-lux.com](http://www.techni-lux.com)